


FD10 Roof-Top Plumbing Vent Pipe Detail

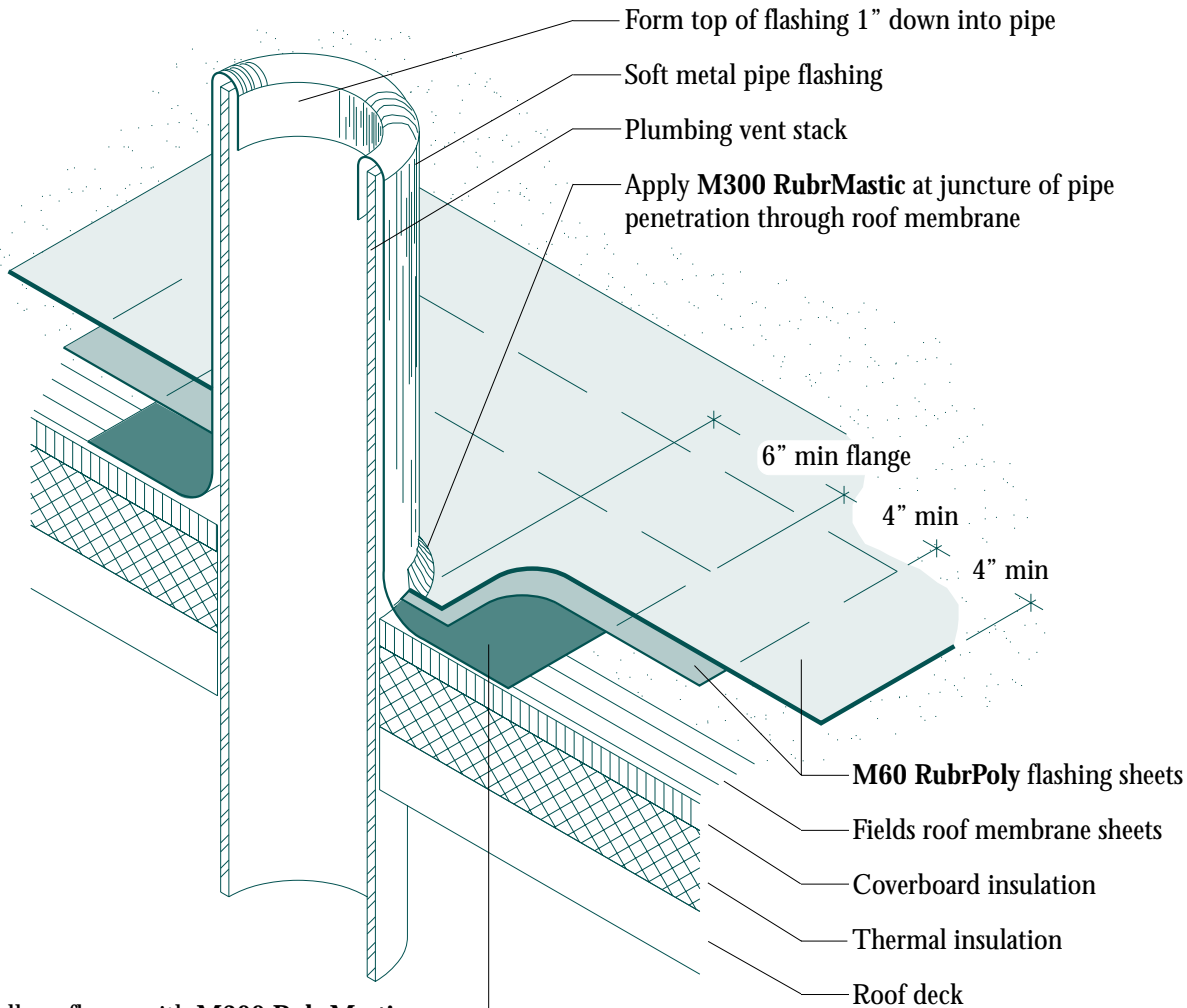

Adhere flange with **M300 RubrMastic**.
Prime top of flange with **M400 RubrPrime**
before flashing with **M60 RubrPoly**

Side View

Notes

- Soft metal pipe flashing:
Minimum sheet lead of 2.25 lb per sq ft or
Minimum sheet copper of 16 oz per sq ft
- If using copper flashing over an iron or steel pipe, insert a separator sheet wrapped around pipe, to separate the copper flashing from direct contact with pipe so as to reduce galvanic reaction.
- Vent stacks and other pipes shall have a min of 12" clearance on all sides from walls, curbs, and other projections to facilitate correct flashing & maintenance.

